

SCREW FIT

4-WAY JUNCTION BOX - Ex eb I, Ex eb IIC, Ex ec IIC, Ex tb IIIC for Hazardous Area Installations

Features and Benefits

- Screw Fit 4-Way Box for use in Group I mining (low impact areas), Group II and Group III applications.
- High-temperature resistance, corrosion resistant and anti-static properties.
- 20mm Box supplied complete with safety securing lid lanyard.
- Raised domed lid facilitates connections to be made outside of the box.
- Only approved CCG cable glands and terminals must be used. No exposed metal parts.
- Dust and waterproof to IP66/68, when used with CCG sealed cable glands.
- No drilling or tapping of cable entries required.
- Mounting studs provided for DIN rail if using Terminal Blocks.
- Internal earthing to all entries and rail provided.
- Screw Fit 4-Way Box can be buried for extended periods.
- Red Fire Rated Box for emergency circuits available (925°C for 3-hours).


Technical Data

| | |
|-----------------------|---|
| Type: | Screw Fit 4-Way - Ex |
| Box Material: | Impact corrosion and UV resistant glass reinforced polyester compound Polycarbonate (see-through adapt-a-lids) O ring seals: Silicone or Sarlink seals. Terminals: Wellamid or Wemidd |
| Optional Accessories: | Ex Certified Terminals (see conditions on safe use-x), Box Spanner (Lid Locking Key). Blanking plugs are provided. |
| Note: | The installer should check that the materials are suitable for the installation environment |

Standards and Certifications

| | |
|------------------------------|---|
| Equipment Protection Levels: | SANS: (Finished) Ex e IIC T6 Gb / Ex nA IIC T6 Gc / Ex tb IIIC T70°C Db SANS: (Unfinished) Ex e IIC Gb / Ex nA IIC Gc / Ex tb IIIC Db IECEX/INMETRO: (Finished) Ex eb I Mb / Ex eb IIC T6 Gb / Ex ec IIC T6 Gc / Ex tb IIIC T70°C Db / Ex tc IIIC T70°C Dc IECEX/INMETRO: (Unfinished) Ex eb I Mb / Ex eb IIC Gb / Ex ec IIC Gc / Ex tb IIIC Db / Ex tc IIIC Dc ATEX/UKEX: (Finished) I M2, II 2GD / 3G Ex eb I Mb / Ex eb IIC T6 Gb / Ex ec IIC T6 Gc / Ex tb IIIC T70°C Db / Ex tc IIIC T70°C Dc ATEX/UKEX: (Unfinished) I M2, II 2GD / 3G Ex eb I Mb / Ex eb IIC Gb / Ex ec IIC Gc / Ex tb IIIC Db / Ex tc IIIC Dc CCC: (Finished) Ex eb IIC T6 Gb, Ex tb IIIC T70°C Db, Ex tc IIIC T70°C Dc CCC: (Unfinished) Ex eb IIC Gb, Ex tb IIIC Db, Ex tc IIIC Dc |
|------------------------------|---|

| | | |
|-----------------------------|---|--|
| Ambient Temperature: | -60°C to +55°C (Finished) | |
| Service Temperature: | -60°C to +110°C (Unfinished) | |
| Conformance: | Standard: | Certificate: |
| IECEX | IEC 60079 Part 0, 7, 31, IEC 60529 | IECEX MSC 20.0003X (Finished) IECEX MSC 20.0004U (Unfinished) |
| ATEX | EN 60079 Part 0, 7, 31 | CML 14ATEX3036X (Finished) |
| | EN 60079 Part 0, 7, 31 | CML 14ATEX4038X (Finished) |
| | EN 60079 Part 0, 7, 31 | CML 14ATEX3037U (Unfinished) |
| | EN 60079 Part 0, 7, 31 | CML 14ATEX4039U (Unfinished) |
| UKEX | EN/BS 60079 Part 0, 7, 31 | CML 21UKEX3008X (Finished) |
| | EN/BS 60079 Part 0, 7, 31 | CML 21UKEX4010X (Finished) |
| | EN/BS 60079 Part 0, 7, 31 | CML 21UKEX3007U (Unfinished) |
| | EN/BS 60079 Part 0, 7, 31 | CML 21UKEX4009U (Unfinished) |
| INMETRO (Brazil) | ABNT NBR IEC 60079 Part 0, 7, 31, IEC 60529 | TÜV 15.0481X (Finished) |
| | ABNT NBR IEC 60079 Part 0, 7, 31, IEC 60529 | TÜV 15.0482U (Unfinished) |
| | GB/T3836.1, 3, 31-2021 | CNEX 21.3507X (Finished) |
| CCC/CNEx (Chinese) | GB/T3836.1, 3, 31-2021 | CCC 2021312303000506 (Finished) |
| | GB/T3836.1, 3, 31-2021 | CNEx 21.3390X (Unfinished) |
| | GB/T3836.1, 3, 31-2021 | CCC 2021312313000393 (Unfinished) |
| | SANS | MASC S/21-9001X (Finished) MASC S/21-9002U (Unfinished) |
| IP66/68 2m Protection | IEC 60529 | IECEX CML 15.0071U |
| Marine ABS | IEC 60529 | ABS 20-SG1952738-1-PDA |
| DNV | IEC 60529 | TAE0000011 |
| Deluge Protection | DTS-01 | CML 14CA370-1 |
| Short Circuit/ Cont.Current | IEC 60947-2, IEC 62444 | CATAPULT OR/15/11677_2 |

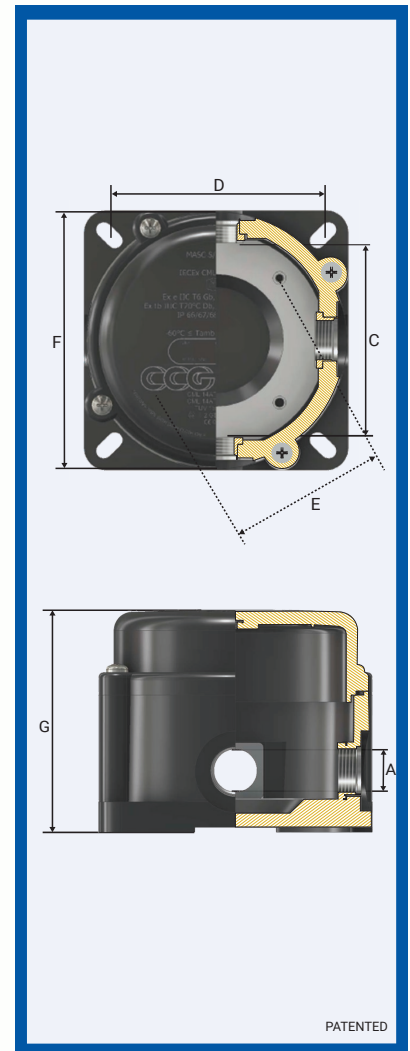

Conditions for safe use

- In Group I applications, the junction box must only be used in low impact areas and where it is not exposed to oils or greases.
- Only the terminal blocks as per the description may be utilised in the junction box. Specific installation conditions as set by the terminal manufacturer/terminal certification must be considered. This includes considering the use of the applicable partitions and end plates for terminal blocks, conductor installation, tightening down of terminal block screws etc.
- Terminal blocks may only be utilized on the applicable rail and must allow sufficient space to make connections and to close the cover/lid.
- IP66/68 glands/plugs must be used in the threaded entries. Information in relation to entries is indicated in the instructions.

| Product Code | Entry Thread 'A' | Distance Between Inserts 'C' | Mounting Centres 'D' | Rail Mounting Centres Holes 'E' | Outer Diameter 'F' | Overall Height 'G' |
|---------------|------------------|------------------------------|----------------------|---------------------------------|--------------------|--------------------|
| 1003-0-M16-SF | M16 | 71.0 | 79.0 | 65.0 | 100.0 | 78.0 |
| 1003-0-SF | M20 | 71.0 | 79.0 | 65.0 | 100.0 | 78.0 |
| 100301-M16-SF | M16 | 88.0 | 92.0 | 80.0 | 118.0 | 98.0 |
| 100301-SF | M20 | 88.0 | 92.0 | 80.0 | 118.0 | 98.0 |
| 100302-M16-SF | M16 | 108.0 | 107.0 | 98.0 | 140.0 | 114.0 |
| 100302-M20-SF | M20 | 108.0 | 107.0 | 98.0 | 140.0 | 114.0 |
| 100302-SF | M25 | 108.0 | 107.0 | 98.0 | 140.0 | 114.0 |
| 100303-M16-SF | M16 | 166.0 | 167.0 | 150.0 | 206.0 | 142.0 |
| 100303-M20-SF | M20 | 166.0 | 167.0 | 150.0 | 206.0 | 142.0 |
| 100303-M25-SF | M25 | 166.0 | 167.0 | 150.0 | 206.0 | 142.0 |
| 100303-SF | M32 | 166.0 | 167.0 | 150.0 | 206.0 | 142.0 |
| 100303-M40-SF | M40 | 166.0 | 167.0 | 150.0 | 206.0 | 170.0 |

All dimensions are in mm.

SCREW FIT 4 WAY JUNCTION BOX

Conditions for Safe Use - X

- The current in the junction box is limited by the size of the conductor and shall not exceed as per the table below.
- Only the terminals listed below may be used, following the specific installation conditions set down by the terminal manufacturer/terminal certification.

| Manufacturer | Certificate No. | Ex Coding | Type | Conductor / Terminal Block Size | Maximum Current | |
|--------------|---|-----------|--|---------------------------------|-----------------|----------------|
| | | | | | ≤ 55°C Ambient | ≤ 40°C Ambient |
| Weidmuller | IEC Ex ULD14.0005U Demko 14ATEX1338U CCC 2021312303000506 | Ex eb IIC | WDU 2.5, 4, 6, 10, 16, 35 and 70N WPE 2.5, 4, 6, 10, 16, 35 and 70N | 2,5 mm ² | 8,34 A | 11,90 A |
| | | | | 4 mm ² | 11,12 A | 15,86 A |
| | | | | 6 mm ² | 14,25 A | 20,33 A |
| | | | | 10 mm ² | 19,81 A | 28,26 A |
| | | | | 16 mm ² | 26,42 A | 37,68 A |
| | | | | 35 mm ² | 43,46 A | 61,98 A |
| | | | | 50 mm ² | 52,50 A | 74,88 A |
| Weidmuller | IECEX TUR18.0024U TÜV 18 ATEX 8221U CCC 2021312313000393 | Ex eb IIC | AKZ2.5 and AKE2.5 AKZ4 and AKE4 | 2,5 mm ² | 8,34 A | 11,90 A |
| | | | | 4mm ² | 11,12 A | 15,86 A |

Wiring and installation instructions for Screw Fit 4-Way Box with components

- Installation must be carried out by a competent person.
- Do not install under live current conditions.
- The box must not be modified in any way, as it may compromise the certification rating.
- All wiring must be carried out in accordance with the relevant Codes of Practice.
- The wiring insulation must not extend by more than 1.0mm from the metal face of the terminal as shown in Figure 1.
- The voltage and current value of the terminals in Table 2 must not be exceeded.
- Only those terminals shown in the terminal schedule may be incorporated in the box, refer Table 1.
- Inner cable bedding must protrude into the box by a minimum of 20mm past the cable entry point.
- Not more than one single or multiple strand lead shall be connected to either side of the terminals.
- Only earth conductors of equal size shall be connected with rail mounted terminals.
- All terminal screws used and unused shall be tightened.
- A parallel shaft screwdriver of the correct size should be used for rail mounted terminals screws.
- Where cables enter the box they must be secured by CCG Cable Glands appropriate to the makeup of the cable.
- Unused entry apertures must be blanked with CCG Non Metallic Plugs.
- To maintain IP66/68 a thread seal gasket between the box and cable gland must be installed.
- Before replacing the lid, ensure the lid gasket is in place.

TABLE 1

| Box Type | Box Size | Terminal Type and Size | Max Quantity | Rail Size |
|-----------------|----------|--------------------------------|--------------|-----------|
| Screw Fit 4 Way | 1 | 2.5mm ² | 12 | 35 |
| Screw Fit 4 Way | 1 | 4mm ² mini terminal | 11 | 15 |
| Screw Fit 4 Way | 1 | 4mm ² | 11 | 35 |
| Screw Fit 4 Way | 1 | 6mm ² | 9 | 35 |
| Screw Fit 4 Way | 1 | 10mm ² | 7 | 35 |
| Screw Fit 4 Way | 1 | 16mm ² | 5 | 35 |
| Screw Fit 4 Way | 2 | 2.5mm ² | 16 | 35 |
| Screw Fit 4 Way | 2 | 4mm ² mini terminal | 14 | 15 |
| Screw Fit 4 Way | 2 | 4mm ² | 13 | 35 |
| Screw Fit 4 Way | 2 | 6mm ² | 11 | 35 |
| Screw Fit 4 Way | 2 | 10mm ² | 8 | 35 |
| Screw Fit 4 Way | 2 | 16mm ² | 7 | 35 |
| Screw Fit 4 Way | 2 | 35mm ² | 5 | 35 |

TABLE 2


VOLTAGE PER TERMINAL CONFIGURATION

| Terminals | Volt | Earth Terminals |
|-----------|------|-----------------|
| AKZ 2.5 | 275V | AKE 2.5 |
| AKZ 4 | 275V | AKE 4 |
| WDU 2.5 | 550V | WPE 2.5 |
| WDU 4 | 550V | WPE 4 |
| WDU 6 | 550V | WPE 6 |
| WDU 10 | 550V | WPE 10 |
| WDU 16 | 550V | WPE 16 |
| WDU 35 | 550V | WPE 35 |
| WDU 70 N | 550V | WPE 70 N |

Tools /Accessories


for general, industrial and mining electrical installations

Pole Mounting Bracket



| Product Code | Box Size Reference |
|--------------|--------------------|
| 401800 | M20 |
| 401801 | M20 |
| 401802 | M25 |


Non Metallic Plugs IP66/68 complete with washer



| Product Code | Metric Dia 'A' | Dia Max 'B' | Dia Max 'C' | Dia Min 'D' | Hex Size Max A/F | Torque Value Nm |
|--------------|----------------|-------------|-------------|-------------|------------------|-----------------|
| 352720 | M20x1.5 | 28.0 | 22.0 | 12.0 | 10.0 | 7.0 |
| 352725 | M25x1.5 | 33.0 | 25.0 | 15.0 | 10.0 | 9.0 |
| 352732 | M32x1.5 | 40.0 | 35.0 | 15.0 | 10.0 | 12.0 |




TS 15 Mini Rail




Mini Terminals for conductor sizes 0.5 to 4mm²

FIGURE 1

The wiring insulation must not extend by more than 1.0mm from the metal face of the terminal as shown below.

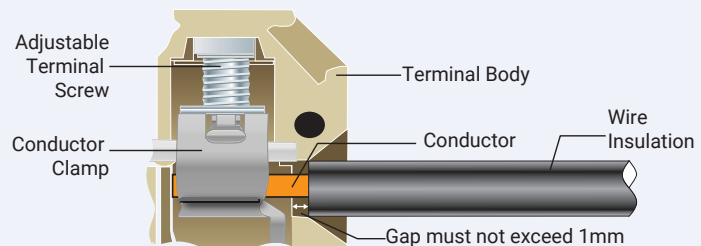

TS 35 Top Hat Rail



Terminals for conductor sizes 0.5 to 70mm²