

D1EX

Ex db IIC, Ex eb IIC, Ex nR IIC, Ex ta IIIC

CAPTIVE COMPONENT GLAND® for Steel Wire Armoured Cable



Features and Benefits

- For indoors, outdoors, Group II, III, Zone 1, 2, 20, 21 and 22 hazardous areas.
- Two-part handling, no loose parts.
- A freely rotating captive cone and inspectable cone ring provides an armour clamp and earth bond on steel wire armour.
- A specially formulated captive elastomeric seal for Built-in Safety™, seals on the inner sheath of the cable IP65/66/68.
- Precision manufactured from high-quality brass (Marine Grade Electroless Nickel Plated™).
- Supplied with a thread-sealing gasket (parallel threads only).



Technical Data

Type:	D1EX
Gland Material:	Brass (Marine Grade Electroless Nickel Plated™)
Seal Material:	Standard Thermoset Elastomer or Extreme Temperature Seals
Sealing Gasket Material:	HDPE, Nylon 66 or PTFE
Cable Type:	Steel Wire Armour
Armour Clamping:	Rotating Captive Cone and Inspectable Cone Ring
Sealing Area:	Inner Sheath
Optional Accessories:	Adaptor, Reducer, Earth Tag, Locknut, Serrated Washer and Shroud
Note:	The installer should ensure that the materials are suitable for the installation environment.

Standards and Certifications


Equipment Protection Levels:	IECEx/INMETRO: Ex db IIC Gb, Ex eb IIC Gb, Ex nR IIC Gc, Ex ta IIIC Da ATEX/UKEx: Ex II 2/3G 1D, Ex db IIC Gb, Ex eb IIC Gb, Ex nR IIC Gc, Ex ta IIIC Da TR CU: Ex I Ex d IIC Gb X / 1Ex e IIC Gb X / 2Ex nR IIC Gc X / Ex tb IIIC Db X	
Continuous Operating Temp:	Standard Seals: -60°C to +95°C/100°C (HDPE/ Nylon Sealing Gasket) Extreme Temp. Seals: -60°C to +160°C (PTFE Sealing Gasket)	
Conformance:	Standard:	Certificate:
IEC/BS EN	IEC/BS EN 62444	CML 14CA364
IECEX	IEC 60079 Part 0, 1, 7, 15, 31	IECEX CML 18.0018X
ATEX	EN 60079 Part 0, 1, 7, 31	CML 16ATEX1001X
	EN 60079 Part 0, 15	CML 16ATEX4002X
UKEX	BS EN 60079 Part 0, 1, 7, 31	CML 21UKEX1011X
	BS EN 60079 Part 0, 15	CML 21UKEX4006X
INMETRO (Brazil)	ABNT NBR IEC 60079 Part 0, 1, 7, 15, 31	TUV 15.0483X
TR CU (Russia)	ГОСТ 31610-0, 15, ГОСТ IEC 60079-1	EA3C RU C-ZA.HA91.B.00245/21
	ГОСТ P MЭК 60079-7, 31	
SANS	SANS/IEC 60079 Part 0, 1, 7, 15, 31	MASC MS/22-9001X
IP66/68 100m - Parallel	IEC 60529	CML 15Y728
IP65/66 - Tapered	IEC 60529	
IP68 - Tapered and approved grease	IEC 60529	IECEX CML 18.0018X
Deluge Protection	DTS-01	CML 14CA370-2
Corrosion Protection	ASTM B117-11, BS EN ISO 3231	EXOVA N968667
Marine ABS	IEC 60079 Part 0, 1, 7, 15, 31, IEC 60529	25-0164964-PDA
DNV	IEC 60079 Part 0, 1, 7, IEC 60529	TAE0000010
EMC Compatible	EN 55011, + A1, EN 55022	SGS EMC305079/1



Conditions for Safe Use - X

- The cable glands shall only be used where the temperature, at the point of entry, is between -60°C to +95°C (standard seals & HDPE sealing gaskets), -60°C to +100°C (standard seal and Nylon sealing gasket) or -60°C to +160°C (extreme temp. seal & PTFE sealing gasket) depending on seal and gasket used.

Note: According to IEC 60079-14, 10.6.2: An Ex d gland will only maintain Ex d integrity when used with substantially round, compact and filled cable. If not a CCG VORTEX® barrier gland should be used.

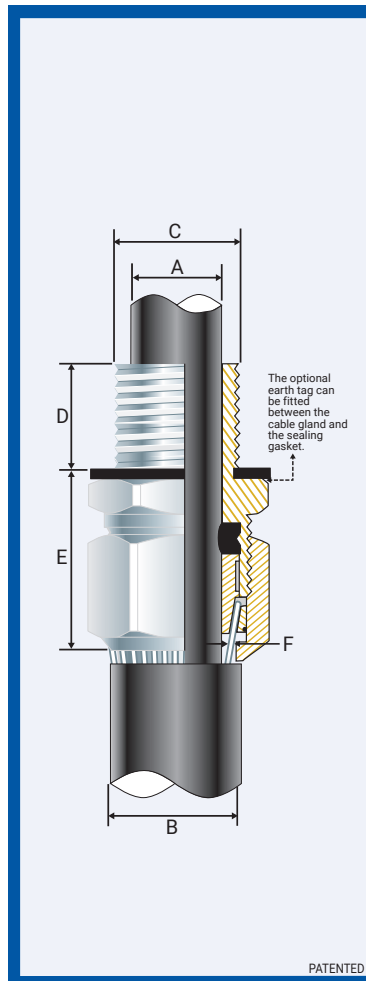

Product Code	Gland Size Reference	Metric Entry Thread		NPT Entry Thread		Cable Detail			Maximum Length 'E'	Armour Dia		Hexagonal Detail		Installation Torque Value Nm
		'C'	Min 'D'	'C'	Min 'D'	Min 'A'	Max 'A'	Max 'B'		Min 'F'	Max 'F'	Max 'Flats'	Max 'Crns'	
051900-16	00-16ss	M16x1.5	15	-	-	3.0	8.5	13.5	53.0	0.20	0.90	24.0	27.0	21.0
051900	00-20ss	M20x1.5	15	1/2/3/4	15	3.0	8.5	13.5	53.0	0.20	0.90	24.0	27.0	21.0
0519-0	0-20s	M20x1.5	15	1/2/3/4	15	7.0	12.0	16.0	53.0	0.20	1.25	24.0	27.0	21.0
051901	1-20	M20x1.5	15	1/2/3/4	15	9.0	15.0	20.5	56.0	0.20	1.25	27.0	30.0	21.0
051922	2s-25s	M25x1.5	15	3/4/1	15/19	11.0	17.5	24.5	60.0	0.20	1.60	35.0	39.0	30.0
051902	2-25	M25x1.5	15	3/4/1	15/19	14.0	20.0	26.5	60.0	0.20	1.60	35.0	39.0	30.0
051933	3s-32s	M32x1.5	15	1/1 1/4	19	15.0	22.0	30.5	66.0	0.20	2.00	42.0	47.0	42.0
051903	3-32	M32x1.5	15	1/1 1/4	19	19.0	26.5	33.5	66.0	0.20	2.00	42.0	47.0	42.0
051944	4s-40s	M40x1.5	15	1 1/4/1 1/2	19/21	22.0	31.5	39.5	78.0	0.30	2.00	52.0	59.0	52.0
051904	4-40	M40x1.5	15	1 1/4/1 1/2	19/21	26.0	34.0	42.5	78.0	0.30	2.00	52.0	59.0	52.0
051955	5s-50s	M50x1.5	15	1 1/2/2	21	29.0	38.0	47.5	87.0	0.40	2.50	65.0	73.0	57.0
051905	5-50	M50x1.5	15	1 1/2/2	21	34.0	44.5	52.5	87.0	0.40	2.50	65.0	73.0	57.0
051966	6s-63s	M63x1.5	15	2/2 1/2	21/30	38.0	50.0	60.5	110.0	0.40	2.50	80.0	90.0	66.0
051906	6-63	M63x1.5	15	2/2 1/2	21/30	44.0	56.5	65.5	110.0	0.40	2.50	80.0	90.0	66.0
051977	7s-75s	M75x1.5	15	2 1/2/3	30/32	50.0	62.0	72.5	118.0	0.40	3.15	96.0	102.0	72.0
051907	7-75	M75x1.5	15	2 1/2/3	30/32	56.0	67.5	78.0	118.0	0.40	3.15	96.0	102.0	72.0
051908	8-80	M80x2.0	20	3	32	59.0	69.0	77.5	175.0	2.50	3.15	96.0	102.0	80.0
051999	9s-90s	M90x2.0	20	3/3 1/2	32/33	66.0	75.0	86.5	184.0	3.00	3.50	111.0	125.0	89.0
051909	9-90	M90x2.0	20	3/3 1/2	32/33	74.0	81.5	91.0	184.0	3.00	3.50	111.0	125.0	89.0
051910	10-100	M100x2.0	20	3 1/2/4	33/34	81.0	91.0	100.0	189.0	3.00	3.50	125.0	141.0	89.0
051911	11-115	M115x2.0	20	4	34	86.0	98.0	114.0	189.0	3.00	4.00	135.0	152.0	175.0
051912	12-120	M120x2.0	20	-	-	95.0	103.0	118.0	189.0	3.00	4.00	140.0	158.0	175.0
051913	13-130	M130x2.0	20	-	-	100.0	115.0	124.0	189.0	3.00	4.00	146.0	164.0	175.0

All dimensions except NPT are in mm. Intermediate thread sizes are available on request. NPT threads should be tightened 'wrench tight'.

CCG reserves the right to make alterations to the technical data, dimensions, designs and products available without notice. The illustrations cannot be considered binding. Please contact CCG for assistance.

D1EX-GH150425

D1EX GLAND

ENCLOSURES AND EQUIPMENT TO WHICH CABLE GLANDS ARE FITTED:-

- Must be made from materials which are compatible with the cable gland materials.
- Have a sealing area around the cable gland entry point with a surface roughness < Ra 6.3 µm.
- Have entries that are perpendicular to the enclosure face in the area where the cable gland will seal to within 2.5°.
- Are sealed using the supplied sealing gasket (parallel threads) or by fully tightening into a threaded entry (tapered threads). Note that for tapered threads the IP rating can be improved to IP68 with the use of a suitable thread sealant.

MUST HAVE THREADED ENTRIES


- The same thread size as the cable gland. (Thread adapters should be used to correct

any mismatch).


- With a thread tolerance of metric class '6H' or equivalent.
- Where the thread length is a minimum of 10mm for Ex d applications or 3mm for all other applications

OR CLEARANCE HOLES (not Ex d)


- Where the hole size is the thread nominal size with a tolerance of +0.1 to +0.7mm. (e.g. the clearance hole for an M20 thread will have a diameter between 20.1mm and 20.7mm).
- Through material that is between 1mm and 12mm thick. (Thicker materials can be accommodated using glands with extended entry threads.)

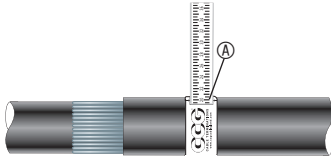


1. For accurate sizing, use a CCG Dimension Tape (A) on the inner and outer cable sheath.

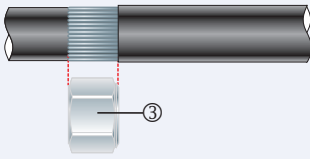

2. Cut back the cable outer sheath to expose the armour to a length not more than the outer (3).




3. To maintain IP66/68, ensure the gasket (1) is in place.

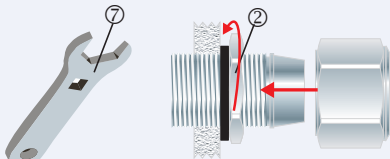


4. Screw the inner (2) into the apparatus and tighten to the installation torque using a CCG Spanner (7).

If the gland has NPT entry threads fitted to a threaded entry then IP68 (2m) can be achieved by applying one of the following tested and approved grease types to the thread:- Renolit Lubrene CA700 or LX220 EP2, Renolit LC-WP2 or Moly LX2, or Dow Corning 4 Electrical Compound.


Alternative installation through an unthreaded entry.




If the apparatus is untapped use a locknut.

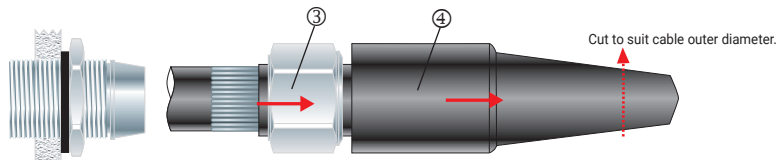


5. Cut the shroud (4) to suit the cable outer diameter. Pass the shroud (4) and the outer (3) over the cable.

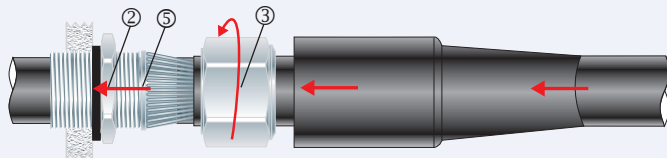

6. Pass the cable end through the inner (2). Splay the armour wires over the cone (5). Tighten the outer (3) onto the inner (2) until hand tight, then tighten with a CCG Spanner (7) with ¾ turn to lock the armour between the cone (5) and the cone ring (6)

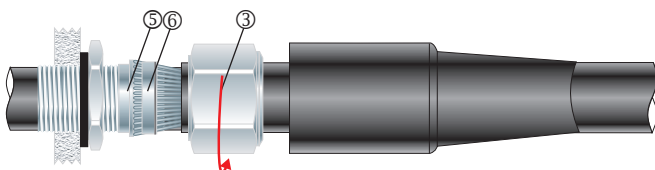

7. Unscrew the outer (3). Check that the armour has locked between the cone (5) and cone ring (6). (O-Ring on the cone (5) and cone ring (6) are sacrificial).

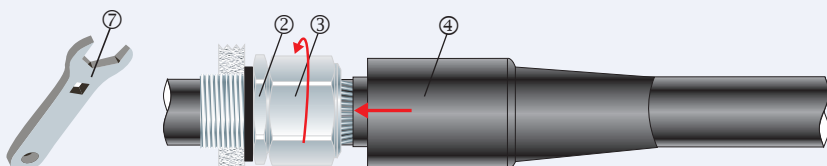

8. Tighten the outer (3) onto the inner (2) to the installation torque using a CCG Spanner (7). Slide the shroud (4) over the gland.