

# **BOTTOM ENTRY ANGLE<sup>™</sup>** JUNCTION BOX - Ex eb I, Ex eb IIC, Ex ec IIC, Ex tb IIIC

### for Hazardous Area Installations

### **Features and Benefits**

- Bottom Entry Angle™ Box for use in Group I mining (low impact areas), Group II and Group III applications. Bottom Entry Angle™ Box for hazardous area lighting applications.
- Sortew-on lid provides ease of installation. Lid locking with a special key prevents unauthorized tampering. Supplied complete with safety securing lid lanyard. Bottom Entry Angle<sup>™</sup> Box is angled to allow ease of termination and inspection. Only approved CCG cable glands and Ex e terminals must be used.

- DIN Rail mounting studs are provided for use with terminal blocks.
- Dust and watertight to IP66/68, when fitted with CCG sealed cable glands.
- No drilling of the cable entries required.
- Internal earthing to all entries and rail.


Technical Data	
Туре:	Bottom Entry Angle™ Box
Box Material:	Impact corrosion and UV resistant glass reinforced polyester compound Polycarbonate (see-through adapt-a-lids) O ring seals: Silicone or Sarlink seals. Terminals: Wellamid or Wemidd
Inserts:	Brass, internal earth continuity ring and earth stud provided
Optional Accessories:	Ex Certified Terminals, Box Spanner (Lid Locking Key) 3-Blanking plugs are provided
Note:	The installer should check that the materials are suitable for the installation environment.
Standarda and Cartif	iestions


#### Standards and Certifications

Stanuarus anu Certinica				
	SSANS: (Finished)Ex e IIC T6 Gb / Ex nA IIC T SANS: (Unfinished) Ex e IIC Gb / Ex nA IIC G IECEX/INMETRO: (Finished) Ex eb I Mb / Ex Ex tb IIICT70°C Db / Ex tc IIIC T70°C Dc IECEX/INMETRO: (Unfinished) Ex eb I Mb / E Ex tb IIIC Db / Ex tc IIIC Dc ATEX/UKEX: (Finished) 😥 I M2 / II 2 GD / II T6 Gb / Ex ec IIC T6 Gc / Ex tb IIIC T70°C Db	c / Ex tb IIIC Db eb IIC T6 Gb / Ex ec IIC T Ex eb IIC Gb / Ex ec IIC Go 3 GD Ex eb I Mb / Ex ebl	76 Gc / c /	F
	ATEX/UKEX: (Unfinished) 🐼 I M2 / II 2 GD, Ex ec IIC Gc / Ex tb IIIC Db/ Ex tc IIIC Dc CCC: (Finished) Ex eb IIC T6 Gb, Ex tb IIIC T CCC: (Unfinished) Ex eb IIC Gb, Ex tb IIIC Db	/ II 3 GD Ex eb I Mb /Ex e 70°C Db, Ex tc IIIC T70°C		
Ambient Temperature: Service Temperature: Conformance:	-60°C to +55°C (Finished) -60°C to +110°C (Unfinished) Standard:	Certificate:		_ <u>↓</u>
IECEx	IEC 60079 Part 0, 7, 31, IEC 60529 IEC 60079 Part 0, 7, 31, IEC 60529 IEC 60079 Part 0, 7, 31, IEC 60529	IECEx CML 15.0072X IECEx CML 15.0071U IECEx TSA 25.0012X	(Finished) (Unfinished) (Finished) (Unfinished)	
ATEX	EN 60079 Part 0, 7, 31 EN 60079 Part 0, 7, 31	CML 14ATEX3036X CML 14ATEX4038X CML 14ATEX3037U CML 14ATEX4039U	(Finished) (Finished) (Unfinished) (Unfinished)	1
UKEX	EN/BS 60079 Part 0, 7, 31 EN/BS 60079 Part 0, 7, 31 EN/BS 60079 Part 0, 7, 31 EN/BS 60079 Part 0, 7, 31	CML 21UKEX3008X CML 21UKEX4010X CML 21UKEX3007U CML 21UKEX4009U	(Finished) (Finished) (Unfinished) (Unfinished)	
INMETRO (Brazil)	ABNT NBR IEC 60079 Part 0, 7, 31, IEC 60529 ABNT NBR IEC 60079 Part 0, 7, 31, IEC 60529		(Finished) (Unfinished)	
CCC/CNEx (Chinese)	GB/T3836.1, 3, 31-2021 GB/T3836.1, 3, 31-2021 GB/T3836.1, 3, 31-2021 GB/T3836.1, 3, 31-2021	CNEx 21.3507X CCC 2021312303000506 CNEx 21.3390X CCC 2021312313000393	(Unfinished)	
SANS	SANS/IEC 60079 Part 0, 7, 31 SANS/IEC 60529	MASC S/21-9001X MASC S/21-9002U	(Finished) (Unfinished)	
IP66/68 2m Protection Marine ABS DNV ClassNK	IEC 60529 IEC 60529 IEC 60529 IEC 60079 Part 0, 7, 31	IECEx CML 15.0071U 25-0167226-PDA TAE0000011 TA25240M		
Deluge Protection Short Circuit/ Cont.Current	DTS-01 IEC 60947-7-2, IEC 62444	CML 14CA370-1 CATAPULT OR/15/1167	7_2	









PATENTED

Conditions and limitations for safe use

In Group I applications, the junction box must only be used in low impact areas and where it is not exposed to oils or greases.

Only the CCG tool supplied shall be used for opening / closing the enclosure.

- Suitably certified cable glands and/or plugs shall be used in the enclosure threaded entries.
- Terminal blocks shall only be used on the applicable rail and shall allow sufficient space to make connections and to close the cover / lid.
- Only the Weidmuller terminals shown in Table 2 may be used.
- The creepage and clearance between terminal blocks and from the terminal block to any earthed / bonded metallic part shall comply with the EN60079-7 requirements for the accentable voltage of the terminal blocks

Product Code	Box Size Ref	Entry Thread 'A'	Inner Diameter 'B'	Distance Between Centres 'C'	Mounting Centres 'D'	Rail Mounting Centres 'E'	Outer Diameter 'F'	Overall Height 'G'
100921-BE	1	M20	66.0	101.0	92.0	81.0	118.0	105.0
100922-BE	2	M25	52.0	123.0	104.0	78.0	140.0	105.0
100923-BE	3	M32	110.0	181.0	165.0	156.0	202.0	140.0

2025 © CCG CABLE TERMINATIONS (PTY) LTD

All dimensions are in mm. CCG reserves the right to make alterations to the technical data, dimensions, designs and products available without notice. The illustrations cannot be considered binding. Please contact CCG for assistance.

## **BOTTOM ENTRY ANGLE<sup>™</sup>** JUNCTION BOX



### Conditions and limitations for safe use

- The current in the junction box is limited by the size of the conductor and shall not exceed as per the table below.
- Only the terminals listed below may be used, following the specific installation conditions set down by the terminal manufacturer/terminal certification.

Manufacturer	Certificate No.	Ex Coding	Туре	Conductor / Terminal Block Size	Maximum Current	
manaraotaroi		LA COULING	.,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,		≤ 55°C Ambient	≤ 40°C Ambient
Weidmuller	IEC Ex ULD14.0005U	Ex eb IIC	WDU 2.5, 4, 6, 10, 16, 35 and 70N	2,5 mm²	8,34 A	11,90 A
	Demko 14ATEX1338U		WPE 2.5, 4, 6, 10, 16, 35 and 70N	4 mm <sup>2</sup>	11,12 A	15,86 A
	CCC 2020322313001819			6 mm <sup>2</sup>	14,25 A	20,33 A
				10 mm <sup>2</sup>	19,81 A	28,26 A
				16 mm <sup>2</sup>	26,42 A	37,68 A
Weidmuller	IECEX TUR18.0024U TÜV 18 ATEX 8221U CCC 2020322313002230	Ex eb IIC	AKZ4 and AKE4	4mm²	11,12 A	15,86 A

### Wiring and Installation instructions for Bottom Entry Angle™ Box without components

- Installation must be carried out by a competent person.
- The box must not be modified in any way, as this will invalidate the certification.
- Where cables enter the box they must be secured by CCG Cable Glands appropriate to the make up of the cable.
- Unused entry apertures must be blanked with certified CCG Blanking Plugs.
- To maintain IP 66/68 a thread seal gasket between the box and cable gland must be installed. Before replacing the lid, ensure the lid gasket is in place.
- The use of a CCG Box Spanner (Lid Locking Key) is required to maintain the tamper proof integrity of the box. refer Figure 1.

### Wiring and Installation instructions for Bottom Entry Angle™ Box<sup>™</sup> with components

- Installation must be carried out by a competent person.
- Do not install under live current conditions.
- The box must not be modified in any way, as this will invalidate the certification.
- All wiring must be carried out in accordance with the relevant Codes of Practice.
- The wiring insulation must not extend by more than 1.0mm from the metal face of the terminal as shown in Figure 2.
- The voltage and current value of the box must not be exceeded.
- See relevant certificate for current limitations for conditions of use / schedule of limitations.
- Only those terminals shown in the terminal schedule may be incorporated in the box, refer Table 1.
- Inner cable bedding must protrude into the box by a minimum of 20mm past the cable entry point.
- Not more than one single or multiple strand lead shall be connected into either side of the terminals.
- Only earth conductors of equal size shall be connected with rail mounted terminals.
- All terminal screws used and unused shall be tightened.
- A parallel shaft screw driver of the correct size should be used for rail mounted terminals screws. Where cables enter the box they must be secured by CCG Cable Glands appropriate to the make up of
- the cable. Unused entry apertures must be blanked with certified CCG Blanking Plugs.

To maintain IP66/68 a thread seal gasket between the box and cable gland must be installed.

Before replacing the lid, ensure the lid gasket is in place.

Box Size Ref

122

2

2 3 3

3

The use of a CCG Box Spanner (Lid Locking Key) is required to maintain the tamper proof integrity of the box, refer Figure 1.

### TABLE 1

Box Type **BE Angle Box** 

BE Angle Box BE Angle Box BE Angle Box BE Angle Box

BE Angle Box BE Angle Box BE Angle Box

BE Angle Box BE Angle Box

BE Angle Box




Screw on, tighten and lock lid in place by means of a CCG Box Spanner (Lid Locking Key).



CCG Box Spanner				
Product Code	Box Size			
4012-0	0			
401201	1			
401202	2			

			TABLE 2			
Terminal Type Max Rail			VOLTAGE PER TERMINAL CONFIGURATION			
Terminal Type and Size	Quantity	Size	Terminals	Volt	Earth Terminals	
4mm <sup>2</sup> mini terminal	8	15				
2.5mm <sup>2</sup>	12	35	AKZ 4	275V	AKE 4	
2.5mm <sup>2</sup>	14	35	WDU 2.5	550V	WPE 2.5	
4mm <sup>2</sup> mini terminal	8	15				
4mm <sup>2</sup>	10	35	WDU 4	550V	WPE 4	
6mm²	8	35	WDU 6	550V	WPE 6	
10mm <sup>2</sup>	7	35				
2.5mm <sup>2</sup>	20	35	WDU 10	550V	WPE 10	
4mm <sup>2</sup> mini terminal	16	15	WDU 16	550V	WPE 16	
4mm <sup>2</sup>	16	35	100 10	8881	WIE 10	
6mm²	12	35				

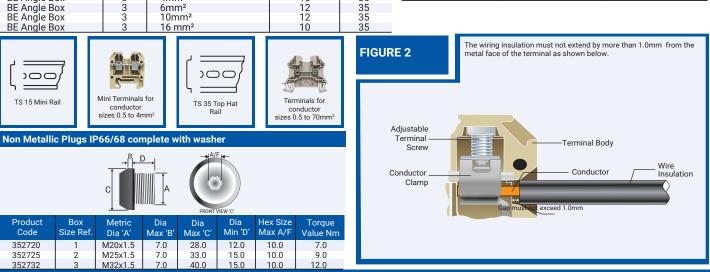

Tel: South Africa +27 11 3942020/1, Australia +1300 CABLE GLANDS (1300 222 534), Hong Kong +852 3427 2090, Singapore +65 6 8421 002, South Korea +82 51 808 1161, United Kingdom +44 1 642 430346, United Arab Emirates +971 6 552 7781